


Determination of the maximum operating frequency dependant on the rating and utilization category
(recommended values) for 400 V

P_N = max. Motor rating (kW) of the contactor to → Page 5/17

S/h = max. operation per hour

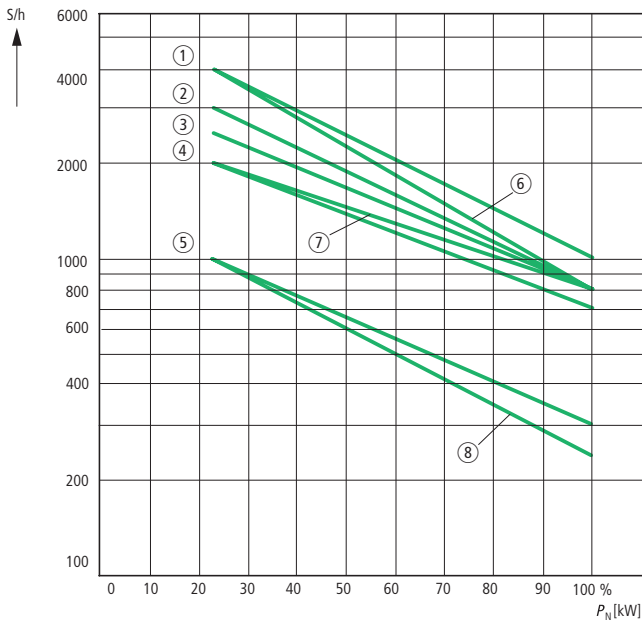

Part no.	Characteristic	AC-3	AC-2 AC-4
DILEM	7	6	8
DILM7, 9, 12, 15	3	1	5
DILM17, 25, 32	3	2	5
DILM40, 50, 65, 72	3	2	5
DILM80, 95, 115, 150, 170	3	4	5


Contactors



Determination of the maximum operating frequency dependant on the rating and utilization category
(recommended values) for 400 V

P_N = max. Motor rating (kW) of the contactor to → Page 5/17

S/h = max. operation per hour

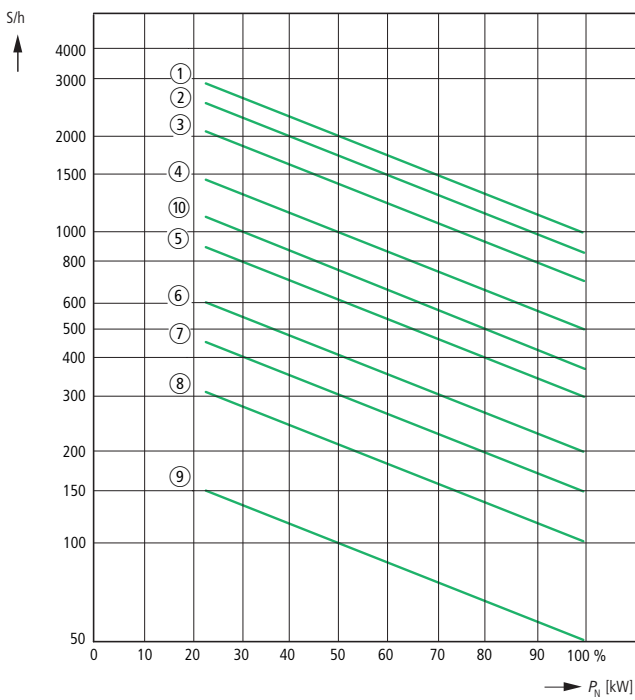

Part no.	Characteristic	AC-3	AC-4
DILM185	2	1	8
DILM225	2	1	8
DILM250	2	1	8
DILM300	3	2	9
DILM400	3	2	9
DILM500	3	2	9
DILM580	3	4	7
DILM650	3	4	7
DILM750	3	4	7
DILM820	3	4	7
DILM1000	3	4	7
DILM1600	10	10	7
DILH1400	10	—	—
DILH2000	10	—	—